
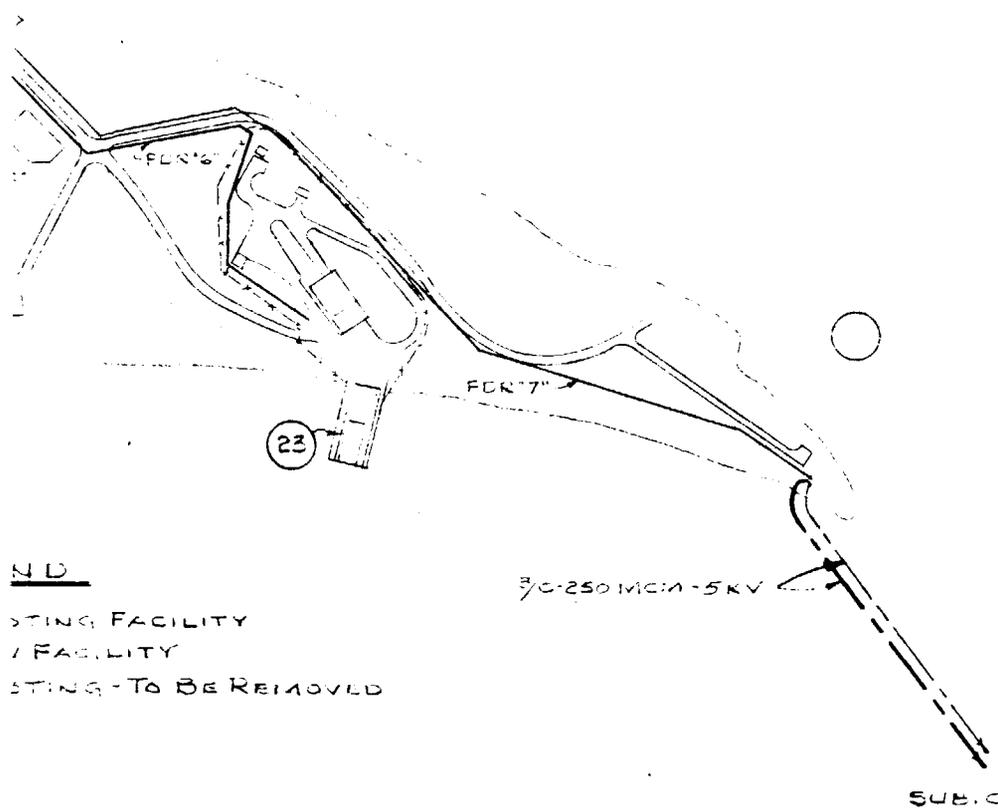


411492

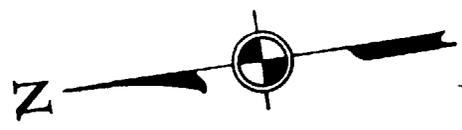

ND  
 STING FACILITY  
 / FACILITY  
 STING - TO BE REMOVED

3/0-250 MCM/A-5KV


SUB. CABLES TO FRED

BEST COPY AVAILABLE

ITEM No	BUILDING	EST. DEMAND LOAD, KW
1	BARRACKS - 3-36 MAN	21
2	BARRACKS - 6-100 MAN	60
4a	REC. FACILITIES - GYM	1.5
4b	REC. FACILITIES - DAY ROOM	6
4c	REC. FACILITIES - HOBBY SHOP	6
5	HOSPITAL ADDITION	3
6	CHAPEL	6
7	GUARD OFFICE & QUARTERS	2
8a	CONSTRUCTION - OFFICE & SHOP	11
8b	SAWMILL	20
9	MACHINE & REPAIR SHOP	200
11	MACHINE REPAIR SHOP	6
12b	PAINT SHOP	12
12d	PAINT STORAGE	7
13	WAREHOUSE	75
22	DEEP WATER PIER	30
23	LSU HAUL OUT FACILITIES	65
24	CMR SALT WATER INTAKE	17
27	MACHINE INJECTOR SHOP	5
28	CAMP ISSUES STOCK ROOM	8
29	ELECTRICAL STORAGE	16
30	DIAL TELEPHONE SYSTEM	5

APPENDIX - IV  
 PROPOSED POWER ADDITIONS  
 FOR FY1955 - SITE ELMER

<b>HOLMES &amp; NARVER</b> INCORPORATED <b>ENGINEERS-CONSTRUCTORS</b> 828 S. FIGUEROA ST., LOS ANGELES 17, CALIF.			
DRAWN BY <b>REJ</b>	CHECKED BY <b>RT</b>	DATE	SHEET NO. <b>SK</b>
JOB NO. <b>884</b>	APPROVED:		<b>354</b>

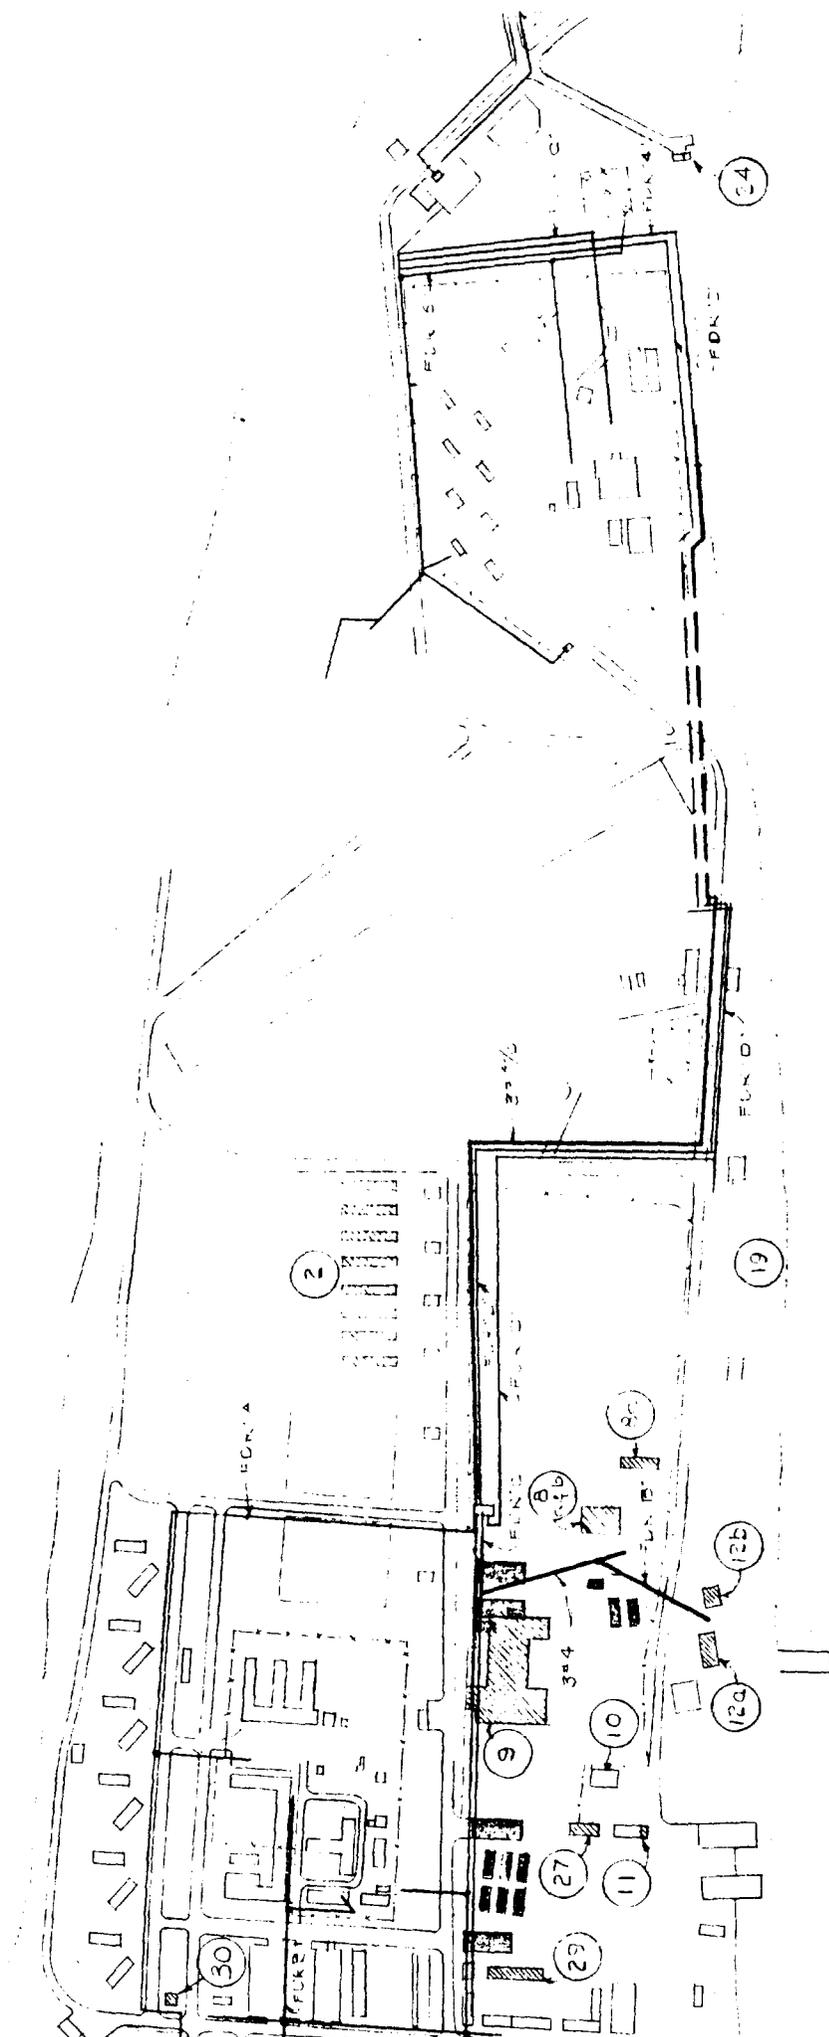

**SYMBOLS**

- OVERHEAD DISTRIBUTION-OPEN WIRE
- - - UNDERGROUND DISTRIBUTION
- NEW
- RECOMMENDED CONSTRUCTION
- OVERHEAD DISTRIBUTION-OPEN WIRE
- UNDERGROUND DISTRIBUTION
- SUBMARINE CABLE

**LEGEND**

- [Symbol] EXISTING FAC.
- [Symbol] NEW FAC.
- [Symbol] EXISTING TO

**E L M E R**  
 SCALE: 1" = 300'

